


3500/33 16-Channel Relay Module

Bently Nevada* Asset Condition Monitoring

Description



The 16-Channel Relay Module is a full-height module that provides 16 relay outputs. Any number of 16-Channel Relay Modules can be placed in any of the slots to the right of the Rack Interface Module. Each output of the 16-Channel Relay Module can be independently programmed to perform needed voting logic.

Each relay utilized on the 16-Channel Relay Module includes "Alarm Drive Logic".

Programming for the Alarm Drive Logic uses AND and OR logic, and can use alarming inputs (Alert and Danger statuses), Not- OK, or individual PPLs from any monitor channel or any combination of monitor channels in the rack. Users program this Alarm Drive using the 3500 Rack Configuration Software to meet the specific needs of the application.

Note: Triple Modular Redundant (TMR) applications must use the 3500/34 TMR Relay Module. Consult the specification and ordering Information for the 3500/34 for details.



Specifications

Inputs

Power

Consumption:

5.8 watts typical.

Outputs

OK LED:

Illuminated when module is functioning properly.

TX/RX LED:

Transmit and Receive. Flashes to indicate proper communications between this module and other modules within the rack.

CH ALARM LED:

Illuminated to indicate that the Relay Channel is in an alarm state.

Relays

Type:

Single-pole, double-throw (SPDT) relays.

Environmental Sealing

Epoxy-sealed.

Arc Suppressor

250 Vrms, installed as standard.

Contact Life

100,000 cycles @ 5 A, 24 Vdc or 240 Vac.

Operation

Four groups of four channels are switch selectable for Normally De-energized or Normally Energized.

Environmental Limits

Operating

Temperature:

-30 °C to +65 °C
(-22 °F to +150 °F).

Storage

Temperature:

-40 °C to +85 °C
(-40 °F to +185 °F).

Humidity:

95%, non-condensing.

Compliance and Certifications

EMC

Standards:

EN 61000-6-2 Immunity for Industrial Environments
EN 55011/CISPR 11 ISM Equipment
EN 61000-6-4 Emissions for Industrial Environments

European Community Directives:
EMC Directive 2004/108/EC

Electrical Safety

Standards:

EN 61010-1

European Community Directives:
2006/95/EC Low Voltage

Hazardous Area Approvals

North American

Approval Option (01)

Class I, Div 2

Groups A, B, C, D

T4 @ Ta = -0 °C to +65 °C

(32 °F to +150 °F)


North American
Approval Option
(02)

**For Selected Ordering Options
with ATEX/North American
agency approvals:**

Ex nC[L] IIC
Class I, Zone 2
Class I, Div 2, Groups A, B, C, D
T4 @ Ta = -20 °C to +65 °C
(-4 °F to +150 °F)

ATEX
Approval Option
(02)

**For Selected Ordering Options
with ATEX/North American
agency approvals:**

 II 3/(3) G
Ex nC[nL] IIC
T4 @ Ta = -20 °C to +65 °C
(-4°F to +150 °F)

Brazil
Approval Option
(02)

**For Selected Ordering Options
with ATEX/North American
agency approvals:**

BR-Ex nC[nL] IIC T4
T4 @ Ta = -20 °C to +65 °C
(-4 °F to +150 °F)

South Africa
Approval Option
(02)

**For Selected Ordering Options
with ATEX/North American
agency approvals:**

Ex nCAL [ia] IIC T4
Ex nCAL [L] IIC T4
T4 @ Ta = -20 °C to +65 °C
(-4 °F to +150 °F)

Note: When used with Internal Barrier I/O Module, refer to specification sheet 141495-01 for approvals information.

For further certification and approvals information please visit the following website:
www.ge-mcs.com/bently

Contact Ratings for Standard Systems

Standard Relays (Resistive load):

Max switched power:

dc: 120 W

ac: 600 VA

Minimum switched current:

100mA @ 12 Vdc

Max switched current:

5 A

Max switched voltage:

dc: 30 Vdc

ac: 250 Vac

TMR Relays:

Max switched current:

2 A

Max switched voltage:

dc: 30 Vdc

ac: 220 Vac

Contact Ratings For Functional Safety Systems and Hazardous Area Systems (Approvals Option 02):

Standard Relays:

5 A and 30 V max

TMR relays:

2 A and 30 V max

Application Advisory

Due to the potential for varying voltage levels, please review the following:

1. 3500 monitors ordered with the multiple approvals option (-02) are certified to Zone 2 standards (including ATEX and North American Zones). The Zone 2 standards specify increased spacing requirements at higher voltages, and the 3500/33 relays do not meet these spacing requirements. For this reason, 3500/33 relays ordered with the multiple approvals option have historically been limited to a lower voltage than those ordered with the other approvals options. Using higher voltages would violate the hazardous area certificates associated with the multiple approvals option. (The North American Division 2 standards associated with the CSA-only approvals option (-01) do not require the same spacing, so that certificate is NOT violated by the increased voltage. It is acceptable with respect to hazardous area requirements to use voltages up to 300 Vdc when the CSA-only approvals option (-01) is ordered.)
2. If the 3500/33 is part of a functional safety (SIL) system, the functional safety certificate requires the restricted voltage. Higher voltages are not allowed for functional safety (SIL) systems.
3. It is possible to connect field wiring to the 3500/33 relays such that conductors are exposed to potential human contact. This could present a shock hazard at high voltages. Customers who wish to use the 3500/33 relays at higher voltages up to 300 Vdc should be advised that the hardware is perfectly capable of handling this voltage but that appropriate safety precautions should be taken with respect to the shock hazard. **Note: maximum allowable power (P) is restricted to 120W. Voltage (V) and/or current (I) must not exceed this limit. (P=IV)**

Physical

Main Module:

Dimensions (Height x Width x Depth):

241 mm x 24.4 mm x 242 mm
(9.50 in. x 0.96 in. x 9.52 in.).

Weight:

0.7 kg (1.6 lb.).

I/O Module:

Dimensions (Height x Width x Depth):

241 mm x 24.4 mm x 99.1 mm
(9.50 in. x 0.96 in. x 3.90 in.).

Weight:

0.4 kg (1.0 lb.).

Rack Space Requirements

Main Module:

1 full-height front slot.

I/O Modules:

1 full-height rear slot.

Ordering Considerations

- The 3500/33 requires 3500 Rack Configuration software, version 3.3 or later
- The 3500/33 requires 3500 Data Acquisition software, version 2.40 or later
- The 3500/33 requires 3500 Data Display software, version 1.40 or later
- When used with a 3500/93 LCD Display module, the 3500/93 will require firmware revision P or later.
- When used with a 3500/94 VGA Display module, the 3500/94 will require firmware revision C or later.

Ordering Information

3500 16-Channel Relay Module

3500/33 -AXX-BXX

A: Output Module

01 16-Channel Relay Output
Module

B: Agency Approval Option

00 None

01 CSA/NRTL/C (Class 1, Div 2)

02 ATEX/CSA (Class 1, Zone 2)

Spares

149986-01

Spare 16-Channel Relay Control
Module

149992-01

Spare 16-Channel Relay Output
Module

04425545

Grounding Wrist Strap (single use)

162291-01


16-Channel Relay Module Manual

00580453

Connector Header, Internal
Termination, 16-position, Green

Graphs and Figures

Figure 1: Front and rear view of the 16-Channel Relay Module

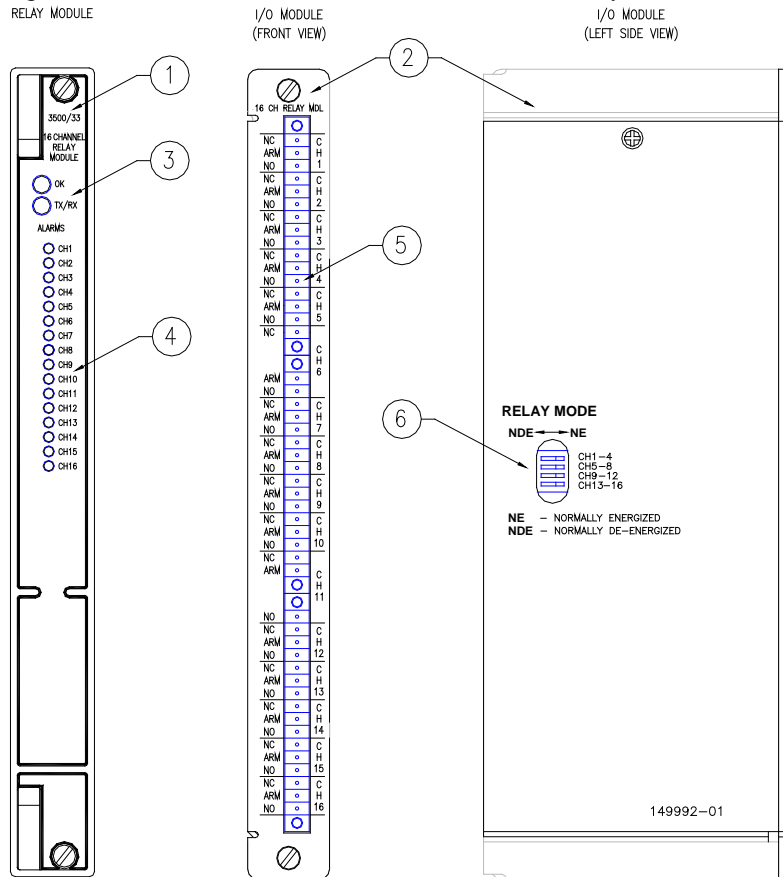

1. Relay module
2. I/O module
3. Status LEDs
4. Relay channel LEDs
5. Relay contacts
6. Relay mode selection switch

* Denotes a trademark of Bently Nevada, Inc., a wholly owned subsidiary of General Electric Company.

© 2002 – 2011 Bently Nevada, Inc. All rights reserved.

Printed in USA. Uncontrolled when transmitted electronically.

1631 Bently Parkway South, Minden, Nevada USA 89423

Phone: 775.782.3611 Fax: 775.215.2873

www.ge-mcs.com/bently