

GE

Intelligent Platforms  
Programmable Control Products

**PACSystems\***  
**RX3i Energy Pack**  
**IC695ACC402**  
**Quick Start Guide**


GFK-2939  
March 2015



## Contents

1.	Overview .....	1
2.	Hardware Installation .....	3
	Mounting the Energy Pack on a DIN Rail .....	3
	Mounting the Energy Pack Directly on a Panel ...	4
	Installation Location .....	4
3.	Cable Connections .....	6
	Connecting to the Energy Pack .....	6
	Connecting the Energy Pack to the Controller ....	6
4.	Grounding .....	7
5.	Power-Up .....	8
6.	LED Indications.....	9
7.	Firmware Updates.....	10
	LED Indications for Firmware Updates .....	10
8.	Replacing the Cap Pack Module .....	11
9.	Additional Information .....	13

# 1. Overview

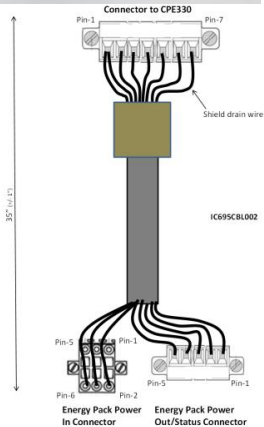

The ACC402 Energy Pack is used exclusively with the CPE330 RX3i CPU. It preserves user memory in the Controller during power fluctuations or outages.

If system power is lost, the Energy Pack maintains power long enough for the connected CPE330 to write its user memory contents to non-volatile memory. When system power is restored, the user memory is restored if the CPE330 is configured to power up from RAM.

The ACC402 Energy Pack is connected to the IC695CPE330 CPU via a dedicated cable IC695CBL002 (shown above). This arrangement allows the Energy Pack to source power from the RX3i backplane in order to charge its circuitry. The cable also allows the CPU to monitor the status of the Energy Pack. Upon loss of backplane power, the CPU automatically switches over to the Energy Pack power source, ensuring an orderly power-down sequence.

### **Ordering Information**

- IC695ACC402 CPE330-compatible Energy Pack.  
Includes Base, Cap Pack module, CPU connecting cable & ground strap.
- IC695ACC412 Replacement Cap Pack module.
- IC695CBL002 Replacement 1m (36") CPU connecting cable.


## 2. Hardware Installation

The ACC402 Energy Pack may be mounted on a standard EN50022 DIN rail or directly on an equipment panel. It is designed to be mounted adjacent to the CPE330 Controller and connected to the Controller using the 1m cable provided (IC695CBL002).

**Heat dissipation:** A minimum clearance of 25mm (1 inch) needs to be provided on all four sides of the unit (right, left, top and bottom).

### ***Mounting the Energy Pack on a DIN Rail***

The Energy Pack snaps easily onto the DIN rail. No tools are required.

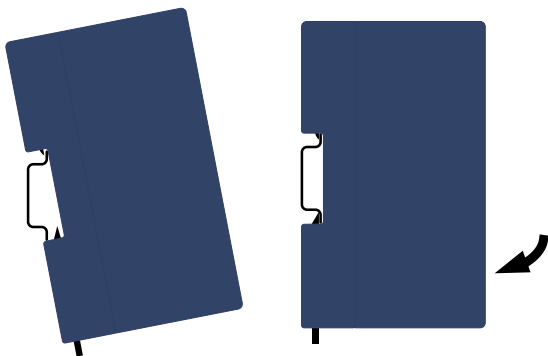

## ***Mounting the Energy Pack Directly on a Panel***

### ***Recommended fasteners:***

The baseplate accommodates four M4-0.7 machine screws (8-36 UNF). Minimum length of 25mm (or 1") is recommended. Secure with matching nuts.



### **CAUTION**

Over tightening the mounting screws could crack the plastic housing.

### ***Installation Location***

This product is intended for use with the RX3i system. Its components are considered open equipment (having live electrical parts that may be accessible to users) and must be installed in an ultimate enclosure that is manufactured to provide safety. At a minimum, the enclosure shall provide a degree of protection against solid objects as small as 12mm (e.g. fingers). This equates to a NEMA/UL Type 1 enclosure or an IEC60529 IP20 rating providing at least a pollution degree 2 environment. For details about installing RX3i rack systems, refer to *PACSystems\* RX3i System Manual*, GFK-2314.

If you need technical help, contact Technical Support. For phone numbers and email addresses, see the back cover of this Guide.

## ***Installation in Hazardous Areas***

The following information is for products bearing the UL marking for Hazardous Areas or ATEX marking for explosive atmospheres:

### ***CLASS 1 DIVISION 2 GROUPS ABCD***

- This equipment is an open-type device and is meant to be installed in an enclosure suitable for the environment that is only accessible with the use of a tool.
- Suitable for use in Class I, Division 2, Groups A, B, C and D Hazardous Locations, or nonhazardous locations only.



**Warning** – EXPLOSION HAZARD -  
SUBSTITUTION OF COMPONENTS MAY IMPAIR  
SUITABILITY FOR CLASS I, DIVISION 2.



**Warning** – WHEN IN HAZARDOUS LOCATIONS,  
TURN OFF POWER BEFORE REPLACING OR  
WIRING MODULES; AND

### ***ATEX Zone 2***

This module must be mounted in an enclosure certified in accordance with EN60079-15 for use in Zone 2, Group IIC and rated IP54. The enclosure shall only be able to be opened with the use of a tool.

### 3. Cable Connections



#### **Connecting to the Energy Pack**

The two connectors on the ACC402 Energy Pack mate with the corresponding two pre-wired pig-tailed connectors of the IC695CBL002 cable assembly. Insert each keyed connector as shown above and secure using the captive screws provided.

#### **Connecting the Energy Pack to the Controller**

With power to the CPE330 Controller turned off, connect the 7-pin keyed connector of the IC695CBL002 cable assembly to the mating connector on the underside of the IC695CPE330 and secure using the captive screws provided.



## **4. Grounding**

Proper grounding of this device is essential. The included ground strap wire must be pressed onto the spade lug connector on the left side of the ACC402. Cable assembly IC695CBL002 ties all internal cable shield drains to this ground.

The frame ground wiring used by both the CPE330 and ACC402 must be connected to a central ground point. The green and yellow ground strap wire (see figure above), which attaches to the spade lug on the side of the ACC402 base plate, must be connected to the central ground point.

All ground wires from the host rack or panel must be as short as possible and terminated at the same grounding point.

## 5. Power-Up

When power is applied to the Energy Pack, the power-up process goes through the following steps:

1. The IN LED turns on green.
2. The Energy Pack performs a self-diagnostic test. If this test passes, output power to the Controller is turned on and the OUT LED turns on (green).
3. Charging of the Cap Pack begins and the STAT LED blinks green.
4. When charging of the Cap Pack is complete, the STAT LED turns on solid green and the Energy Pack signals to the controller that it can start run-time operation. The Controller will not start running its application until the Energy Pack signals that it is fully charged.
5. If the Energy Pack is faulty or is not communicating, the Controller will commence operations after a timeout period (90 sec).



## 6. LED Indications

<b>LED</b>	<b>State</b>	<b>Energy Pack Status</b>
IN	Green, solid	Input power is applied and within the specified range.
	Red, solid	Input power is outside the specified range.
	Off	Input power is not applied.
STAT	Green, blinking	Charging of Cap Pack is in progress. No fault exists.
	Green, solid	Cap Pack is fully charged and no fault exists.
	Amber, blinking	Cap Pack is nearing end-of-life. The Cap Pack must be replaced soon. Backup is still guaranteed.
	Red, blinking	Internal fault: Cycle power to the Energy Pack. If this does not clear the fault, contact Technical Support and replace the Energy Pack.
	Red, solid	Cap Pack has reached end-of-life. Replace the Cap Pack. Backup is <b>not</b> guaranteed.
	Off	No power applied.
OUT	Green, solid	Output power is within the specified range.
	Red, solid	Output power is present but is outside the specified range.
	Off	Output power is not present.

## 7. Firmware Updates

The firmware for the Energy Pack is automatically updated by the Controller. At power-up, the Controller checks the version of Energy Pack firmware to verify compatibility with the Controller firmware. If an update is needed, the Controller performs it automatically.

### ***LED Indications for Firmware Updates***

Firmware Update Mode	All three LEDs blink <b>green</b>
Failed to Load Firmware	All three LEDs blink <b>red</b>

## 8. Replacing the Cap Pack Module

The status of the Energy Pack is provided at %S0014 (#PLC\_BAT) and %SA0011 (#LOW\_BAT). User programs should monitor these status bits in order to alert for maintenance conditions. Refer to *PACSystems RX7i and RX3i CPU Reference Manual*, GFK-2222V or later.

The Cap Pack may be removed and replaced while power is applied to the Energy Pack (hot swapped.)

### CAUTION



When hot swapping Cap Packs, do not cycle power until the new Cap Pack is fully charged and operational. Cycling power before the STAT LED is solid green can result in Controller memory not being preserved. Do not hot remove/insert the Cap Pack during the firmware update process

1. Loosen the four screws on the Cap Pack and carefully pull the Cap Pack off the base.
2. Install the new Cap Pack on the base, first engaging the module-to-base connectors and then pressing the Cap Pack into place.



### CAUTION

Over tightening the mounting screws could crack the plastic housing.

3. Use the four screws provided to secure the Cap Pack to the base.
4. When the Cap Pack is first inserted, the STAT LED blinks green while the Cap Pack is charging. Do not remove power to the Energy Pack while the Cap Pack is charging because this could result in Controller memory not being preserved.

Following a hot swap insertion, the Cap Pack will draw only a small current in order not to disrupt overall power requirements. As a result, it may take up to 10 mins to reach its full charge. This is normal.

The Energy Pack LEDs and the associated status bits indicate when charging is complete and the Energy Pack is ready to support backup.

5. To remove a Failed Battery fault and clear the associated status bits, clear the Controller Fault Table.

For details on user programming based on status bit operation, refer to the *PACSystems\* RX7i and RX3i CPU Programmer's Reference Manual*, GFK-2950.

## **9. Additional Information**

*PACSystems\* RX3i Power Sync and Measurement System, GFK-2748*

*PACSystems\* RX3i 1GHz 64MB CPU w/Ethernet Quick Start Guide, GFK-2941A*

*PACSystems\* Controllers: Battery and Energy Pack Manual, GFK-2741C or later*

*PACSystems\* RX3i Energy Pack IC695ACC402 Important Product Information, GFK-2940*

*PACSystems\* RX7i and RX3i CPU Reference Manual, GFK-2222V or later*

*PACSystems\* RX3i System Manual, GFK-2314*

*PACSystems\* RX7i and RX3i CPU Programmer's Reference Manual, GFK-2950*

For user manuals, product updates and other information go to the Support website, <http://www.ge-ip.com/support> and refer to *Controllers and IO, RX3i Controllers*.



GE Intelligent Platforms

Contact Information

**Americas:** 1-800-433-2682 or 1-434-978-5100

Global regional phone numbers are available on our web site

[www.ge-ip.com](http://www.ge-ip.com)

©2015 General Electric Company. All Rights Reserved

\*Trademark of GE Intelligent Platforms, Inc.

All other brands or names are property of their respective holders

**GFK-2939**